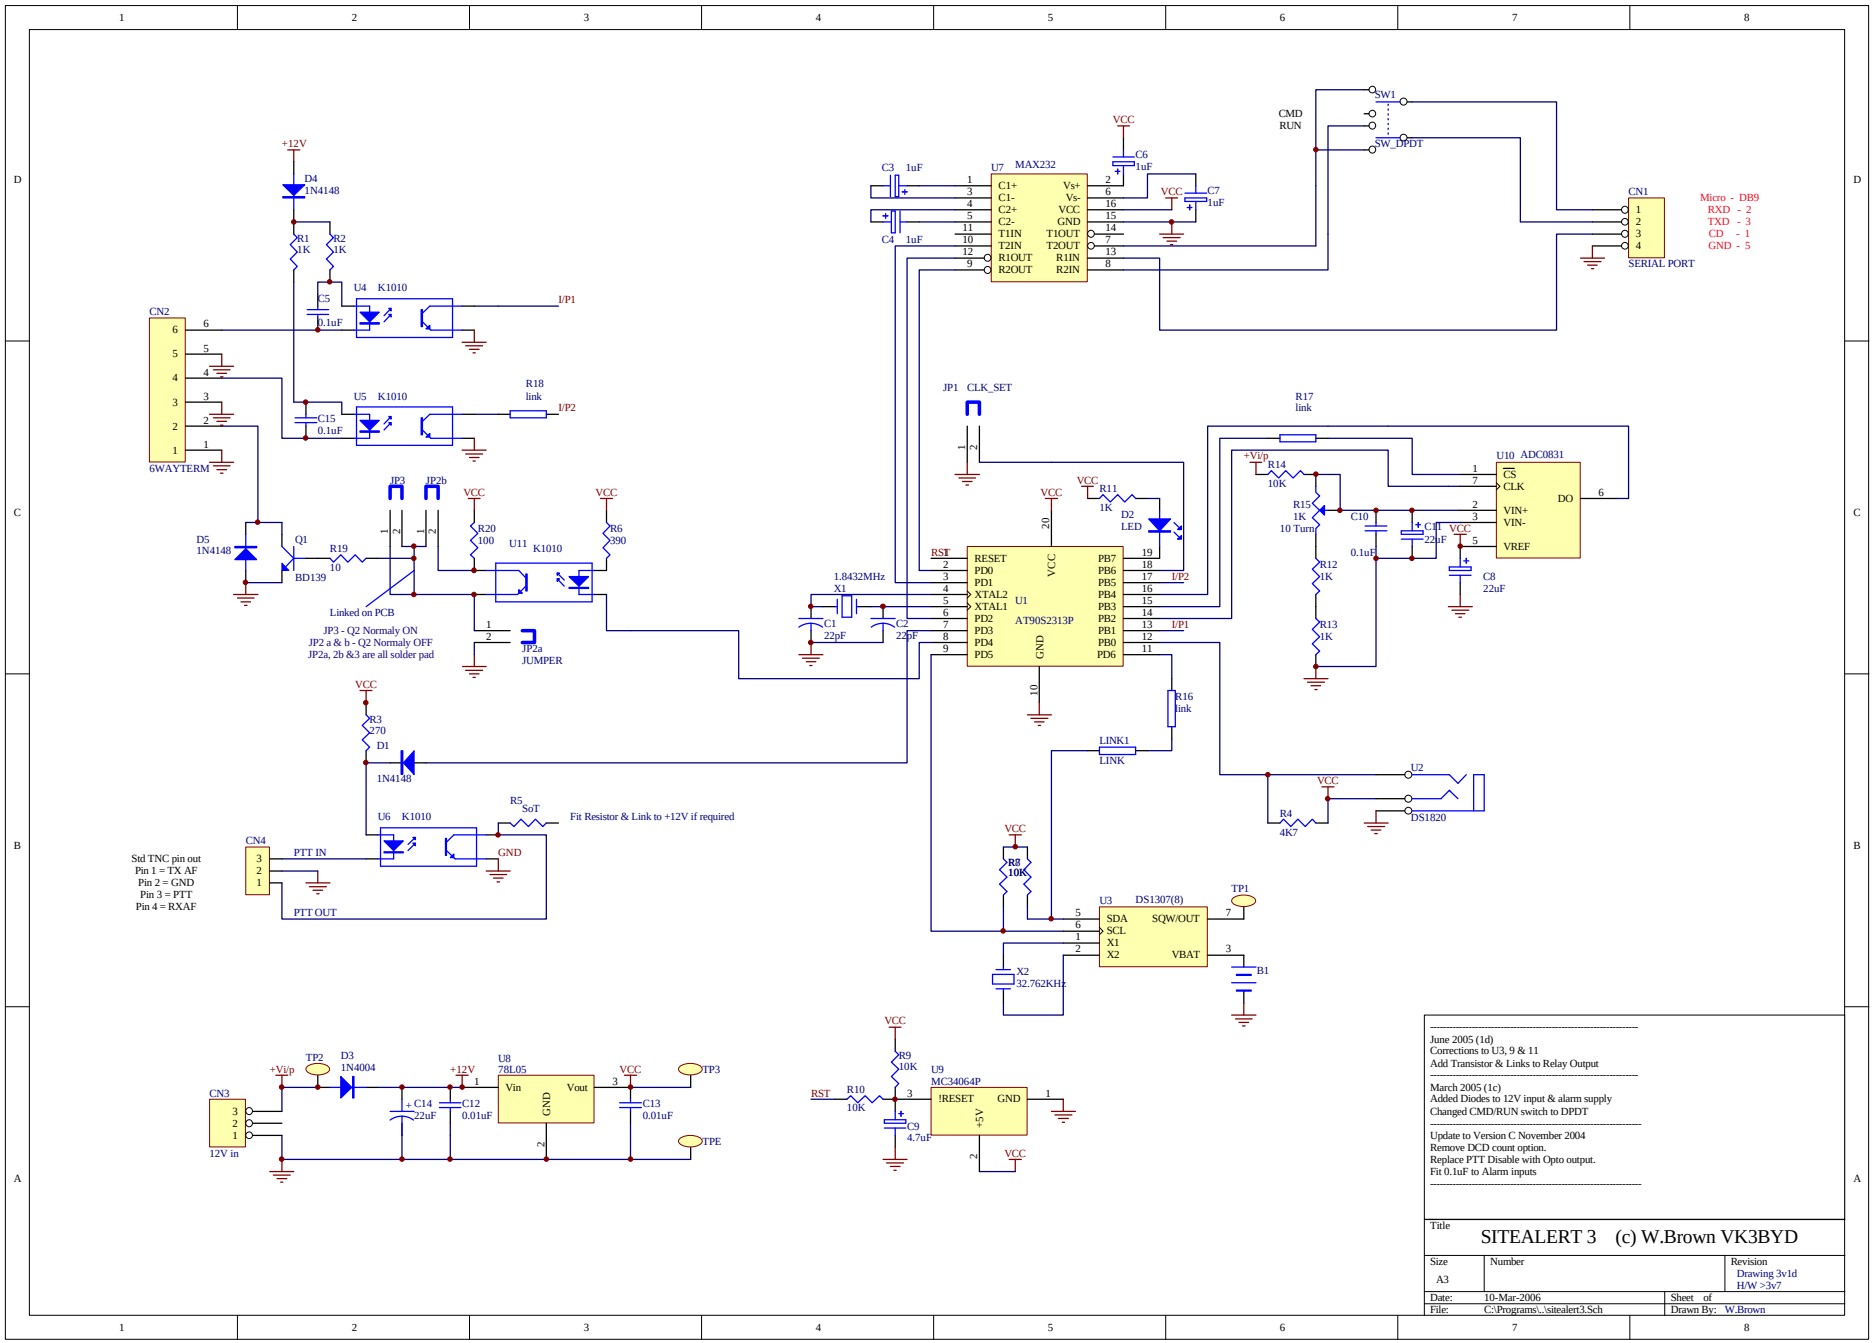

June 2005 (1d)
Corrections to U3, 9 & 11
Add Transistor & Links to Relay Output

March 2005 (1c)
Added Diodes to 12V input & alarm supply
Changed CMD/RUN switch to DPDT

Update to Version C November 2004
Remove DCD count option.
Replace PTT Disable with Opto output.
Fit 0.1uF to Alarm inputs

Title	SITEALERT 3 (c) W.Brown VK3BYD	
Size: A3	Number	Revision: Drawing 3v1d H/W >3v7
Date: 10-Mar-2006		Sheet of
File: C:\Programs\..\sitealert3.Sch		Drawn By: W.Brown